


**RECEIVED**  
AUG 20 2025

Kititas County CDS

SERVICE ROAD 903

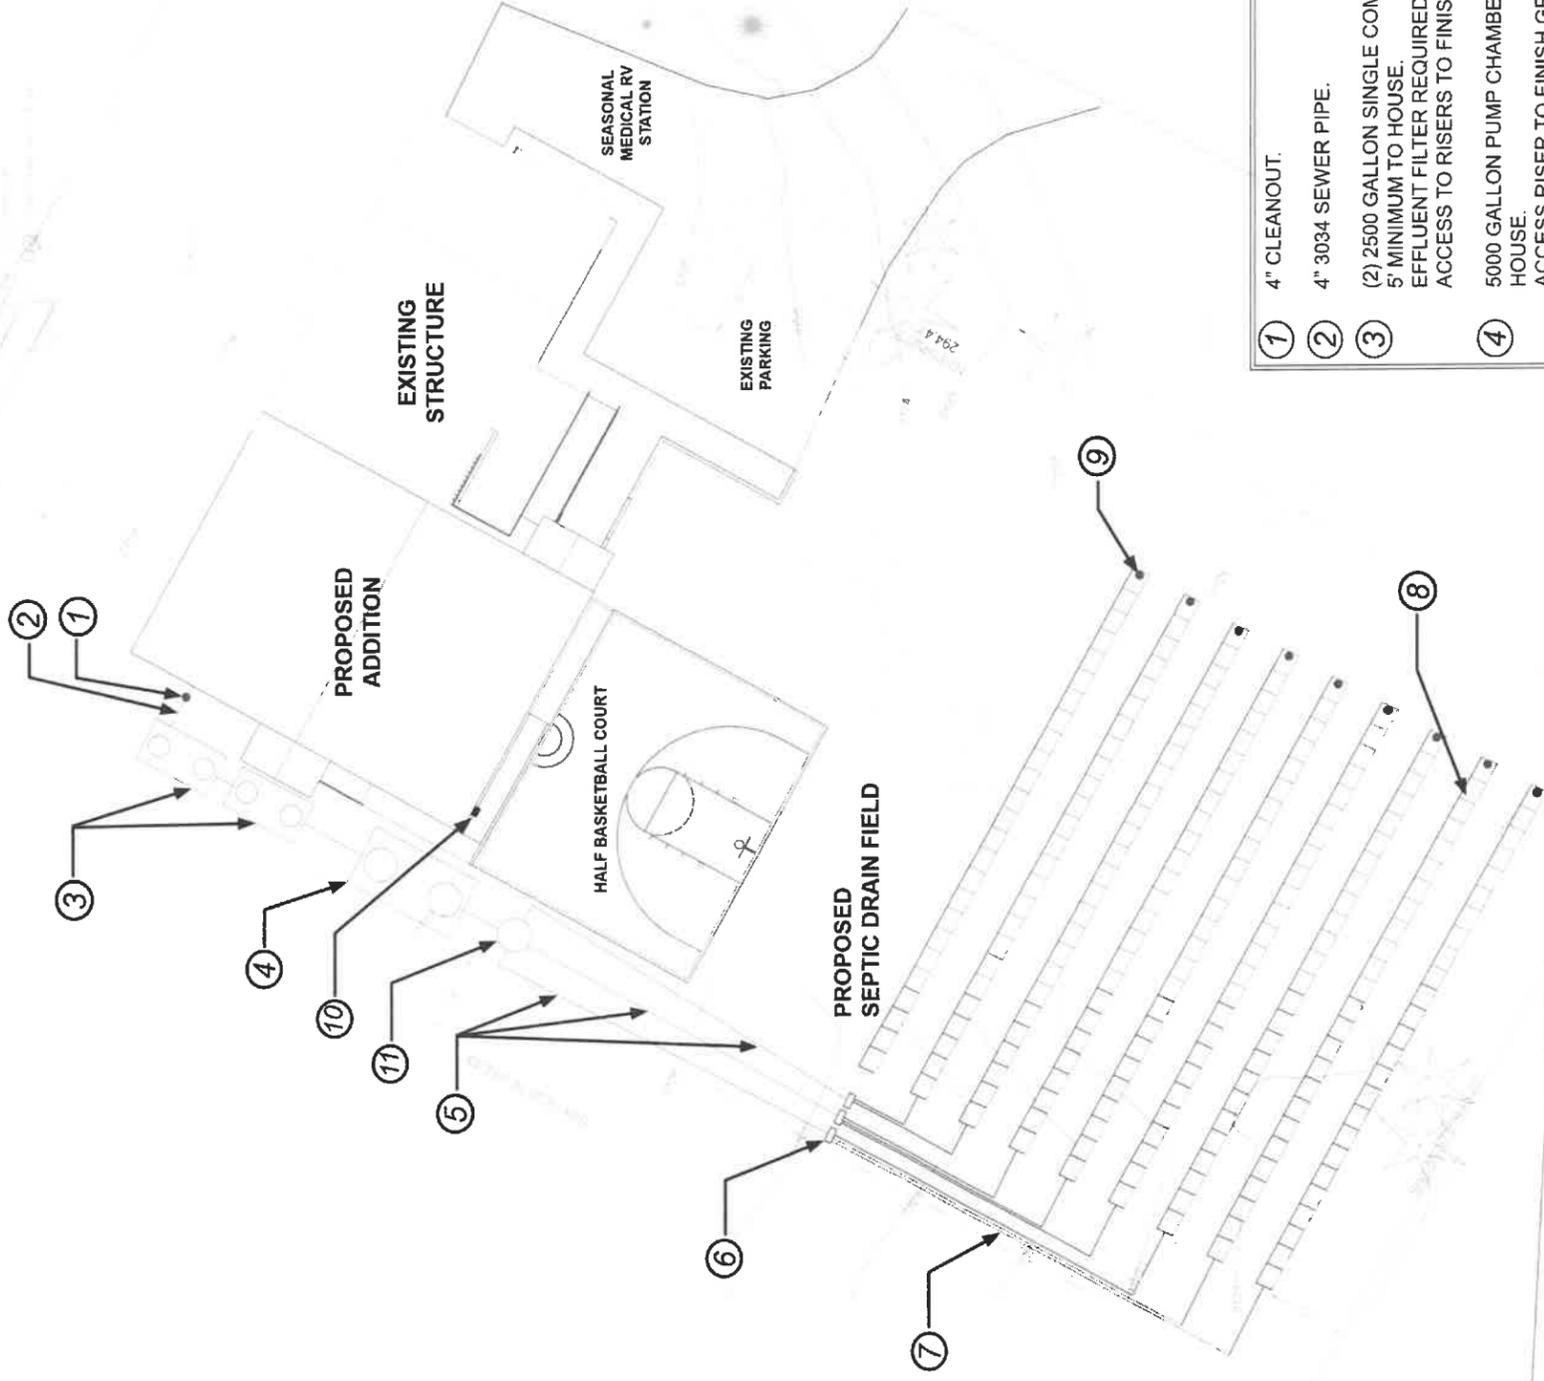

100% RESERVE  
101' X 125'  
ON SEPARATE PARCEL  
SEE EASEMENT AGREEMENT

- ① 4" CLEANOUT.
- ② 4" 3034 SEWER PIPE.
- ③ (2) 2500 GALLON SINGLE COMP. TANK. 5' MINIMUM TO HOUSE. EFFLUENT FILTER REQUIRED. ACCESS TO RISERS TO FINISH GRADE REQUIRED.
- ④ 5000 GALLON PUMP CHAMBER 5' MINIMUM FROM HOUSE. ACCESS RISER TO FINISH GRADE REQUIRED.
- ⑤ 2" SCHEDULE 40 TRANSPORT LINE.
- ⑥ 1.5" PVC BALL VALVES IN VALVE BOX. 5' MINIMUM FROM DRAINFIELD.
- ⑦ 1.5" SCHEDULE 40 PVC LATERALS WITH 3/16" ORIFICES DRILLED ON 5' CENTER.
- ⑧ 9-100' LATERALS ON 10' CENTERS. 3 - THREE LATERAL LOBES FROM INDEX VALVE MAXIMUM DEPTH IS 26". INFILTRATOR Q4 LP CHAMGERS TO BE USED 5' MIN. TO PROPERTY LINES AND EASEMENTS. 100' MINIMUM TO WELLS. 10' MINIMUM TO BUILDINGS.
- ⑨ 4" INSPECTION PORTS TO FINISH GRADE AT EACH LATERAL END.
- ⑩ SJE RHOMBUS TIME DOSED PANEL. PANEL MOUNTED WITHIN LINE OF SIGHT OF THE PUMP CHAMBER. ELAPSED TIME METER AND DOSE COUNTER ARE REQUIRED.
- ⑪ 3 - ZONE HYDROINDEXING VALVE INSTALLED IN ENCLOSED RISER VAULT. LOCATE ON HIGH POINT OF FIELD AREA. ORENCO MODEL HIV 6503.

**THE BOYS & GIRLS CLUB  
OF THE COLUMBIA BASIN**  
08/19/25

SEPTIC SITE PLAN

