




# KITTITAS COUNTY FIRE MARSHAL'S OFFICE

411 N. Ruby St., Suite 2, Ellensburg, WA 98926

Office (509) 962-7000 Fax (509) 962-7682

## Utilities allowed in the same Trench

A minimum soil separation of 12" is required between any gas line and electrical line. Electrical may be in the same trench unless specific utility requirements do not allow this application.

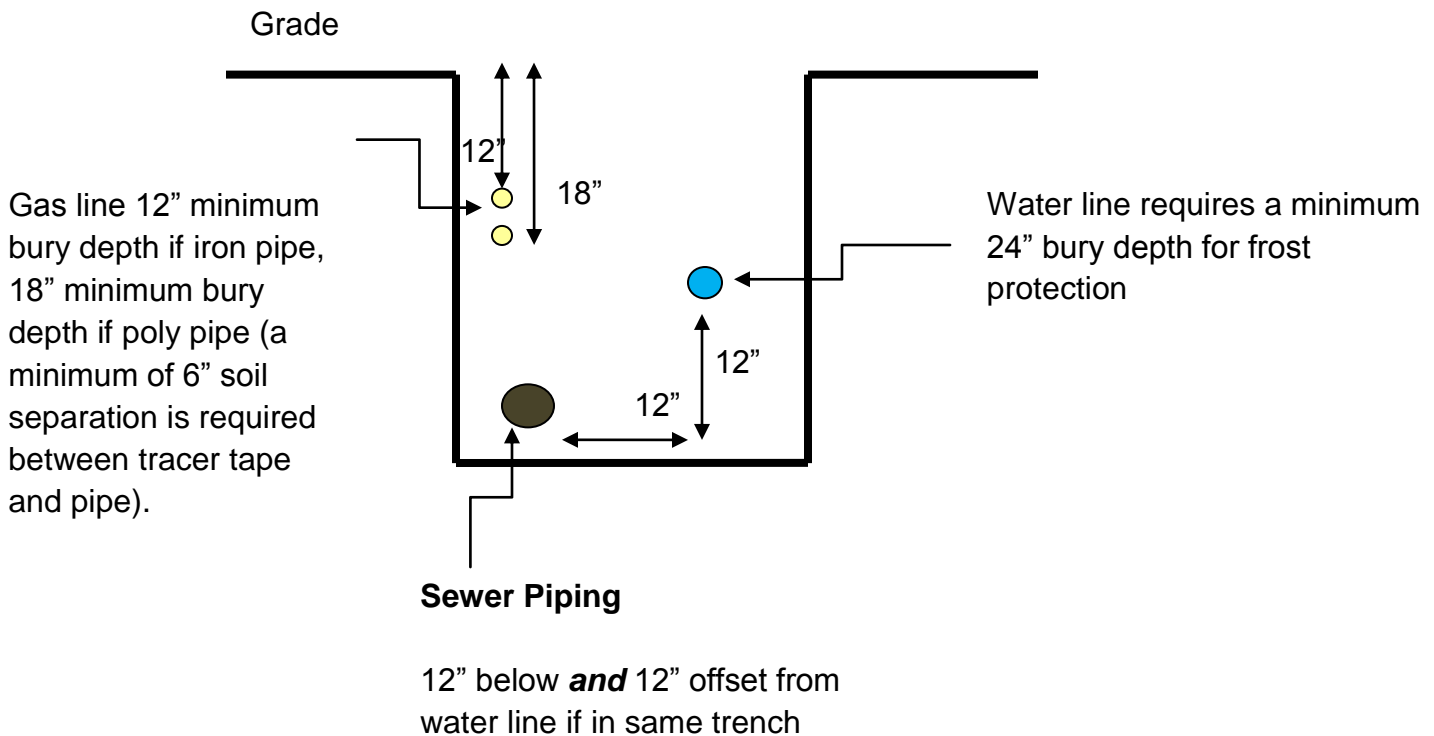

\*Check with local utilities for specific utility-owned line depth and clearance.

